

N

N

5.52%

1GW 3GW  
N TOPCon  
N P  
7 15 8  
N TOPCon PERC  
5.52%

Tiger Neo N  
2023 7 15 -8  
N P  
N TOPCon  
5.52%

N29°56'50.75" E100°37'1.94"  
4000m-4600m  
6434.8MJ/m<sup>2</sup>

N TOPCon 4600m  
N TOPCon P  
5.52%

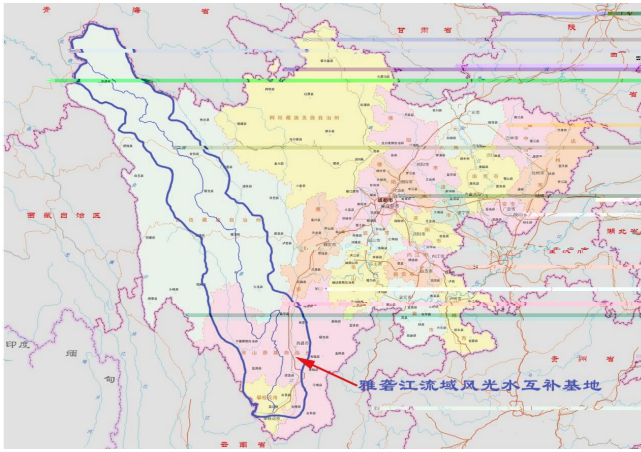


图1: 项目位置

74  
149 163  
26° ± 45° 10.5  
1.8 196kW  
26  
1.21 1.15  
N TOPCon P PERC

1%-1.5% 10  
1% 0.4%  
N TOPCon  
IEC61215 UV+TC+HF  
0.16% PVEL PQP  
DH2000 N TOPCon  
0.55% N TOPCon

|              | kWh       | kWh/kW |       |
|--------------|-----------|--------|-------|
| N 型 570Wp 双面 | 532046.15 | 137.55 | 5.52% |
| P 型 545Wp 双面 | 471000.17 | 130.35 |       |

表1:N型和P型组件发电量及增益对比

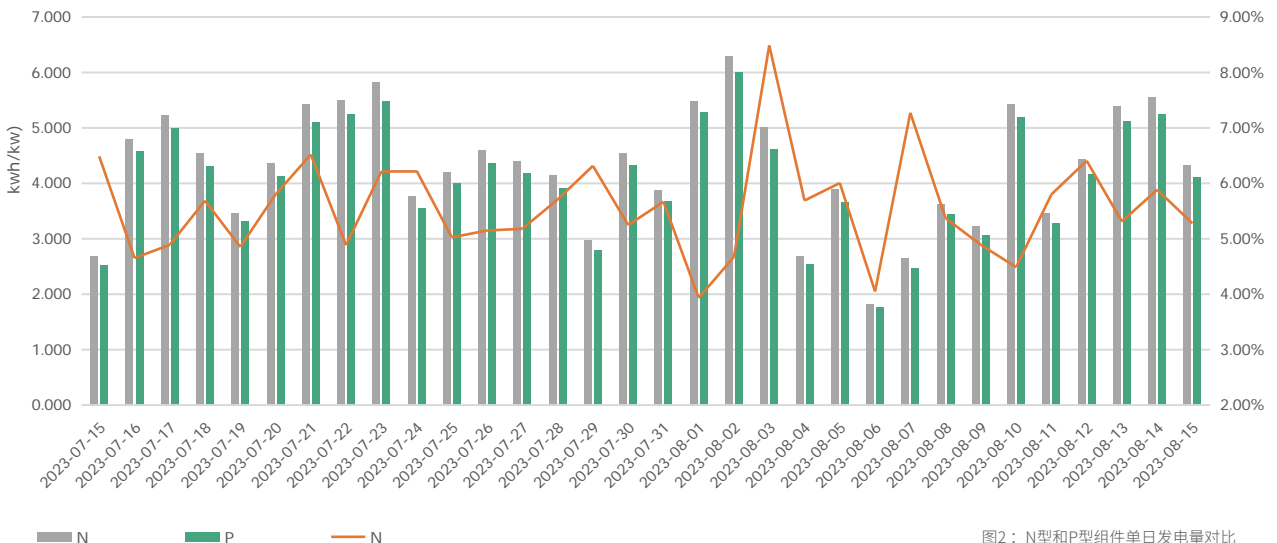


图2: N型和P型组件单日发电量对比